

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: EXTRUDED RIGID PVC.
11. UNITS MUST BE GLAZED PER ASTM E1300.
12. UNITS MUST INSTALLED WITH 3/16" POLYCARBONATE STORM COVERING. SEE INSTALLATION DETAILS.

13. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE ROOFING NAILS (.105" Ø MINIMUM) WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - 19.1. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - 19.2. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - 19.3. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - 19.4. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .125" THICK MINIMUM
20. SERIES 2100 SH WINDOW MAY INSTALLED USING THE FOLLOWING IMPACT PROTECTION COVERING:
 - 20.1. MUHLER STORM COVERING, SEE SHEET 11 FOR INSTALLATION DETAILS.
 - 20.2. 1/8" THICK POLYCARBONATE FOR UNITS WITH FRAME AREA UP TO 13.87 FT², SEE SHEET 11 FOR INSTALLATION DETAILS.
 - 20.3. 3/16" THICK POLYCARBONATE FOR UNITS WITH FRAME AREA UP TO 27.6 FT², SEE SHEET 11 FOR INSTALLATION DETAILS.
 - 20.4. IMPACT PROTECTION SYSTEM APPROVED BY THE FLORIDA STATEWIDE APPROVAL SYSTEM.

SIGNED: 01/09/2024


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 - 3	ELEVATION
4 - 8	INSTALLATION DETAILS
9	COMPONENTS

ALL AMERICAN WINDOW COMPANY, LLC. 1930 HANAHAN ROAD, SUITE 1400A NORTH CHARLESTON, SC 29406		
SERIES 2100 SINGLE HUNG WINDOW W/STORM JAMB - IMPACT NOTES		
DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 1 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

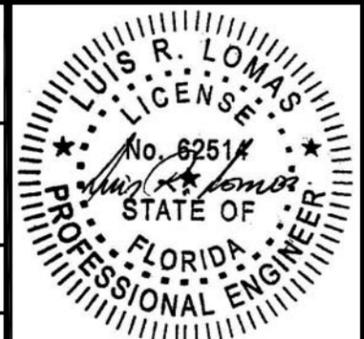


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

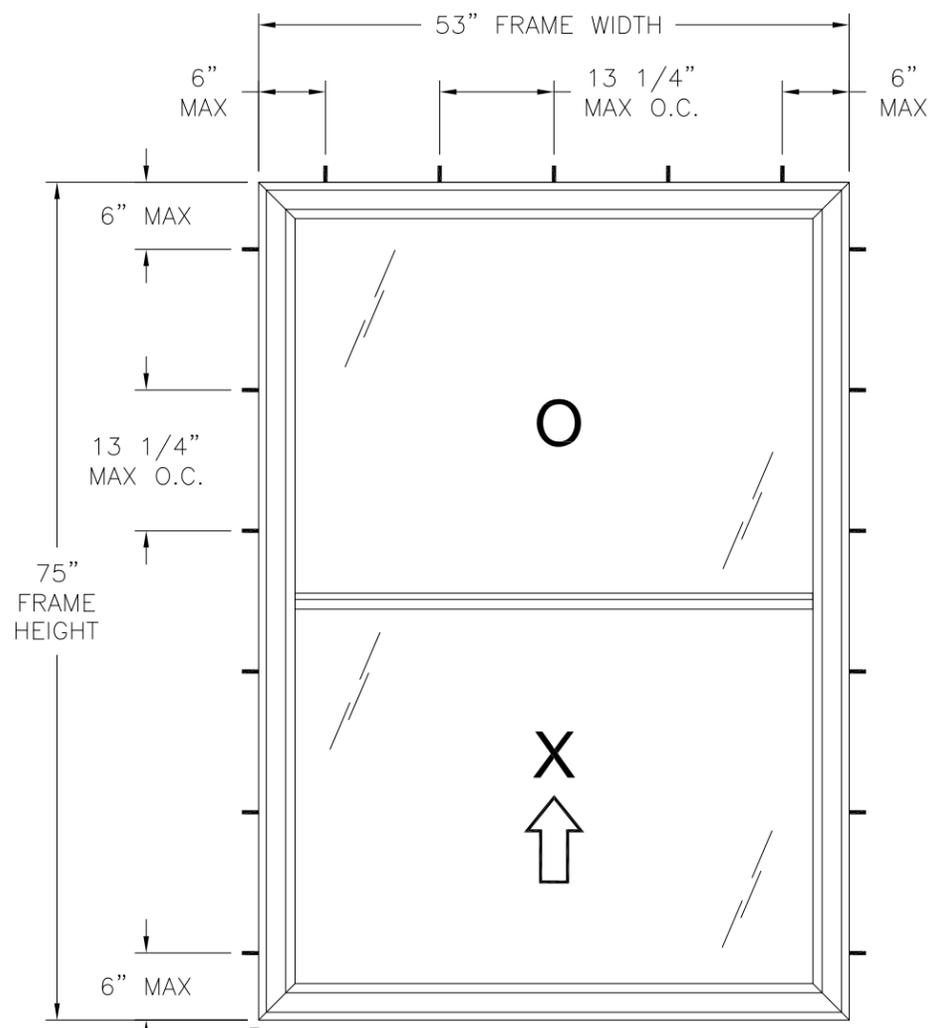

SERIES 2100 SINGLE HUNG WINDOW
EXTERIOR VIEW
FRAME INSTALLATION

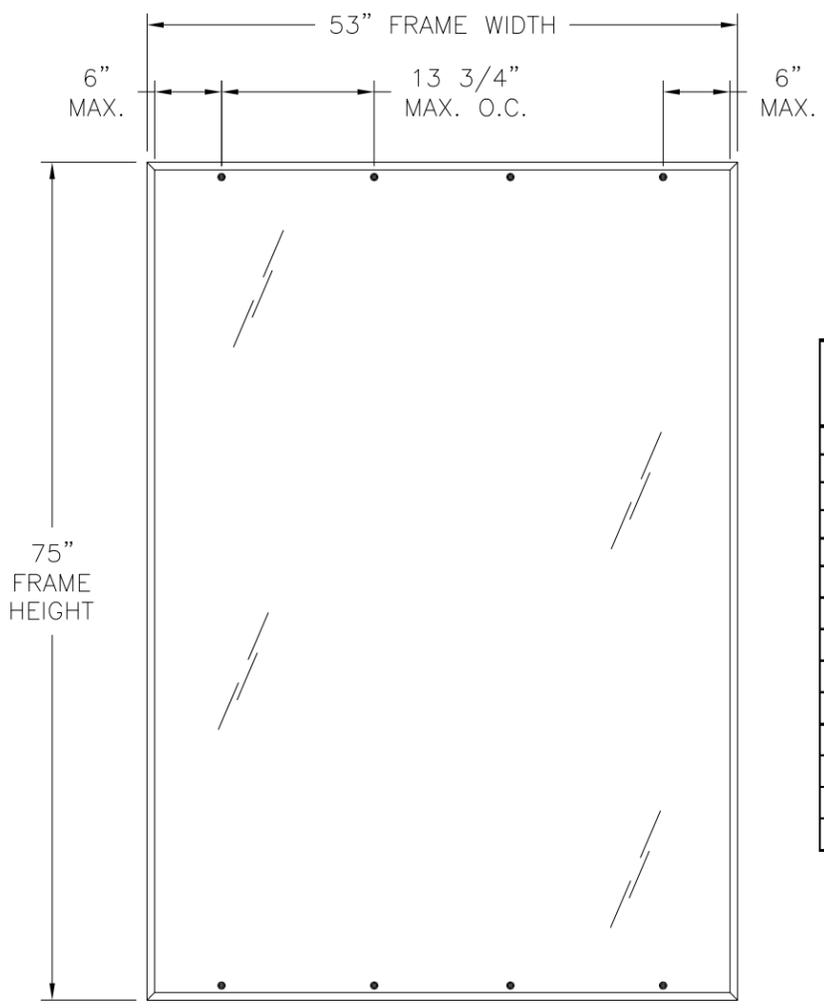

SERIES 2100 SINGLE HUNG WINDOW
EXTERIOR VIEW
STORM COVERING INSTALLATION

Chart #1
Where water penetration resistance is required
Design pressure rating (psf)

Frame Height (in)	Frame width (in)													
	24.00		30.00		36.00		42.00		48.00		53.00		60.00	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
24.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
30.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
36.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	48.2	48.2
42.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	41.9	41.9
48.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	37.2	37.2
54.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	48.2	48.2	33.7	33.7
60.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	45.1	45.1	30.9	30.9
66.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.4	49.4	42.7	42.7	28.7	28.7
72.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	47.6	47.6	40.8	40.8	-	-
75.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	46.8	46.8	40.0	40.0	-	-
78.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	46.2	46.2	-	-	-	-
84.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-	-	-	-
90.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-	-	-	-
96.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-	-	-	-	-

- NOTES:
 1. SASH SIZE: 50 3/4" X 37 1/4"
 2. D.L.O.: 46 7/8" X 33 3/4"

DESIGN PRESSURE RATING	IMPACT RATING
±40.0PSF	NONE

53" X 75" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS FRAME AREA DOES NOT EXCEED 27.6 FT² SEE CHART #1 FOR OTHER SIZE RATINGS

HARDWARE SCHEDULE	
A.	CONSTANT FORCE BALANCE SYSTEM AT FRAME JAMBS
B.	SWEEP LOCK AT 8 1/2" FROM EACH JAMB
C.	ALUMINUM REINFORCEMENT AT FIXED MEETING RAIL

ALL AMERICAN WINDOW COMPANY, LLC.
 1930 HANAHAN ROAD, SUITE 1400A
 NORTH CHARLESTON, SC 29406


SERIES 2100 SINGLE HUNG WINDOW
 W/STORM JAMB - IMPACT
 ELEVATION FRAME INSTALLATION

DRAWN: A.R. DWG NO. 08-03573 REV A

SCALE NTS DATE 06/18/2020 SHEET 2 OF 12


L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@rlomaspe.com

SIGNED: 01/09/2024

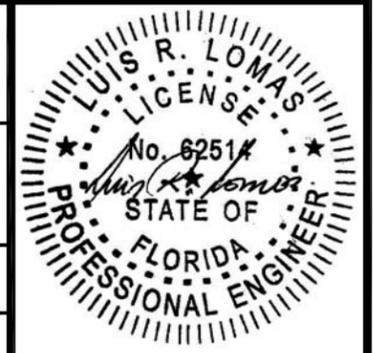


Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

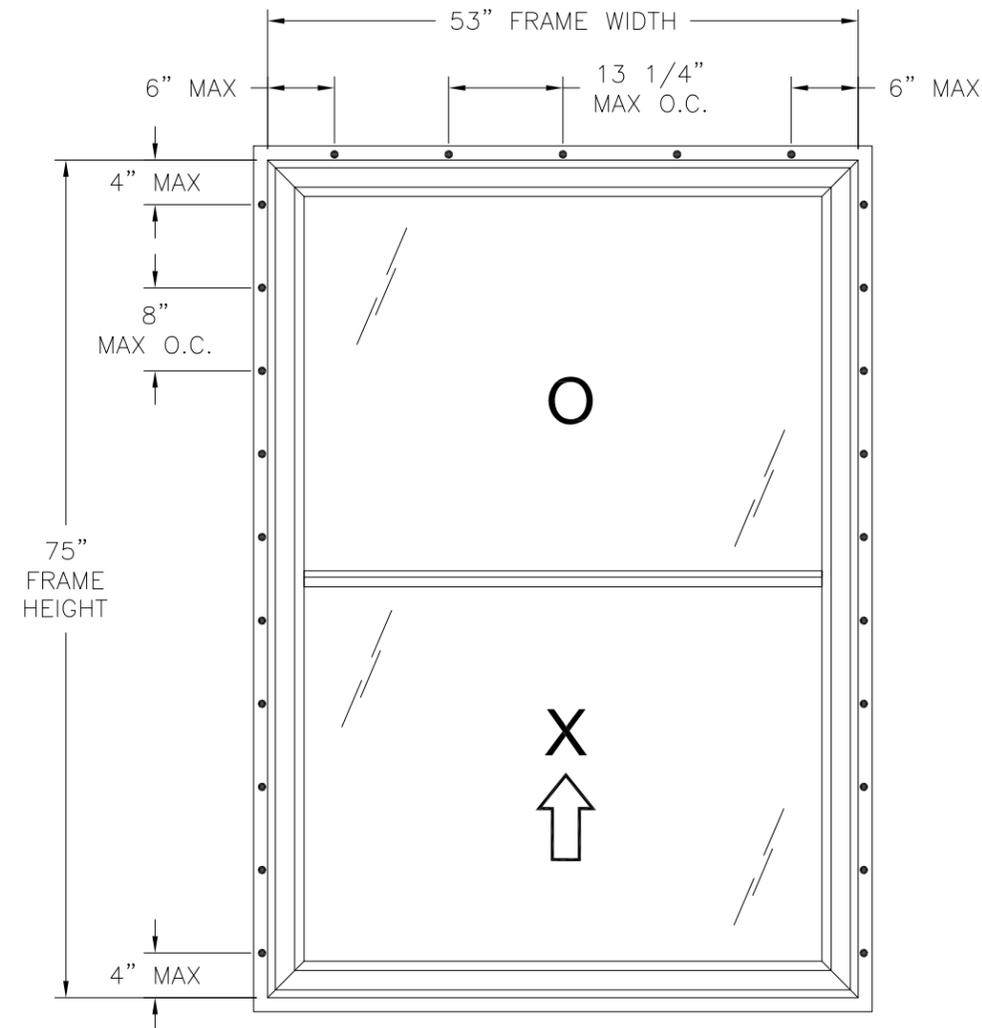

SERIES 2100 SINGLE HUNG WINDOW
EXTERIOR VIEW
FIN INSTALLATION
WITH ROOFING NAILS

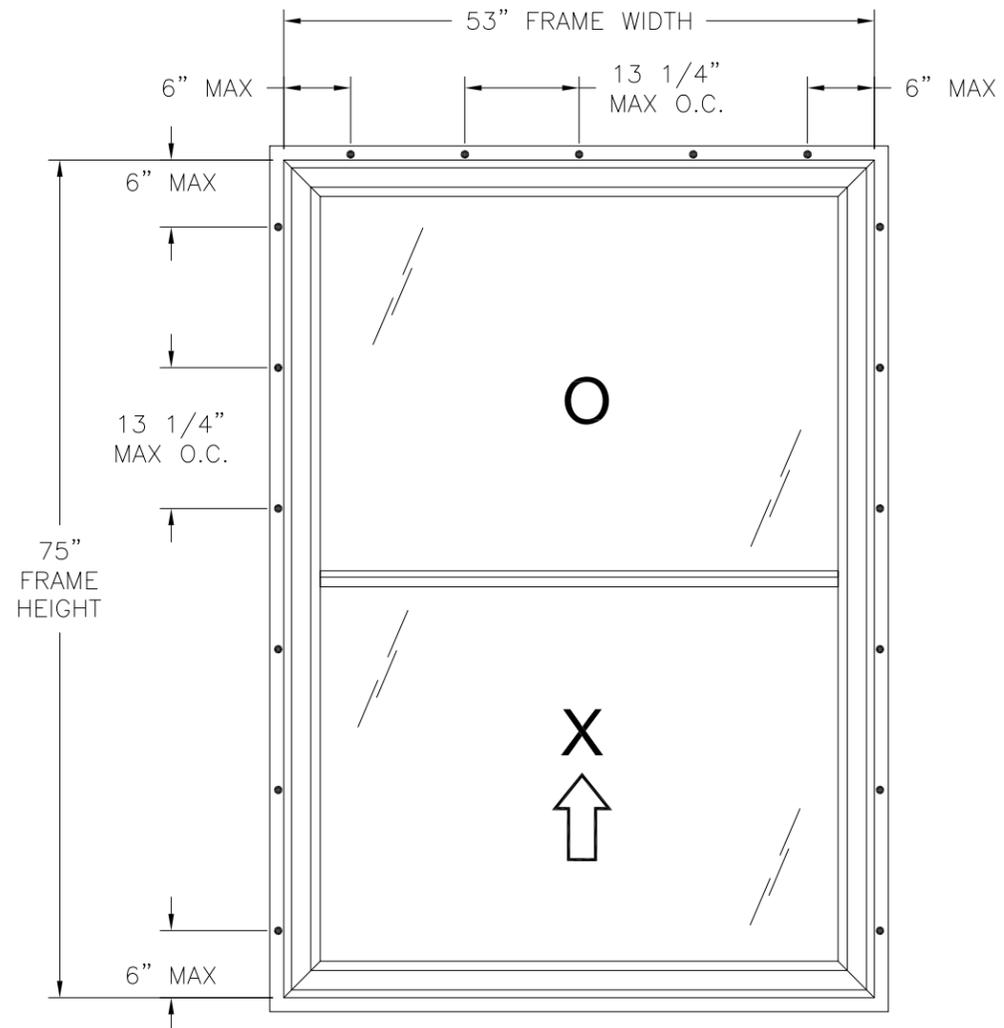

SERIES 2100 SINGLE HUNG WINDOW
EXTERIOR VIEW
FIN INSTALLATION
WITH WOOD SCREW

- NOTES:
1. SASH SIZE: 50 3/4" X 37 1/4"
2. D.L.O.: 46 7/8" X 33 3/4"

DESIGN PRESSURE RATING	IMPACT RATING
±40.0PSF	NONE

53" X 75" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 27.6 FT²
SEE CHART #1 SHEET 2 FOR OTHER SIZE RATINGS

HARDWARE SCHEDULE	
A.	CONSTANT FORCE BALANCE SYSTEM AT FRAME JAMBS
B.	SWEEP LOCK AT 8 1/2" FROM EACH JAMB
C.	ALUMINUM REINFORCEMENT AT FIXED MEETING RAIL


ALL AMERICAN WINDOW COMPANY, LLC.
1930 HANAHAN ROAD, SUITE 1400A
NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
W/STORM JAMB – IMPACT
ELEVATION FRAME INSTALLATION

DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 3 OF 12


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 01/09/2024

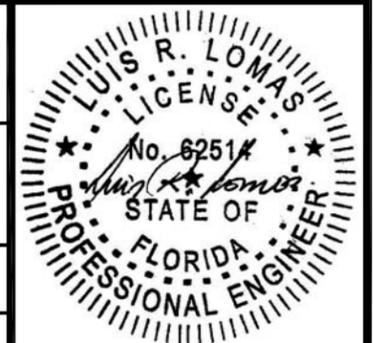

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

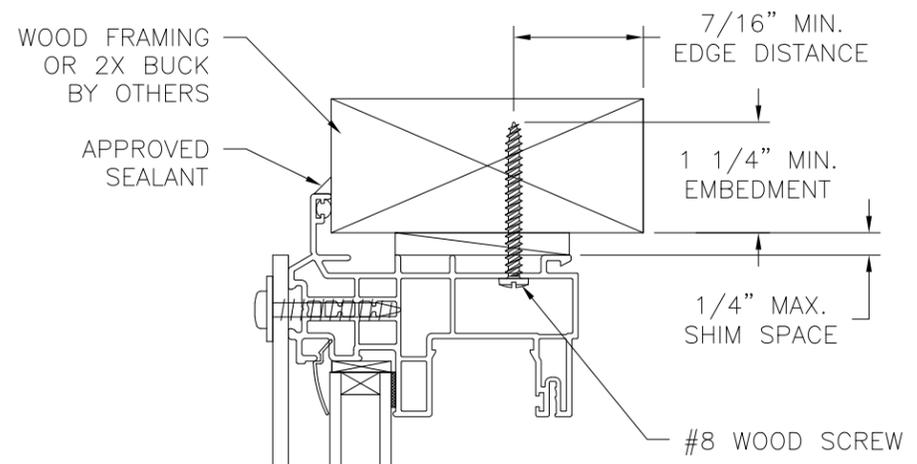

EXTERIOR

INTERIOR


IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11

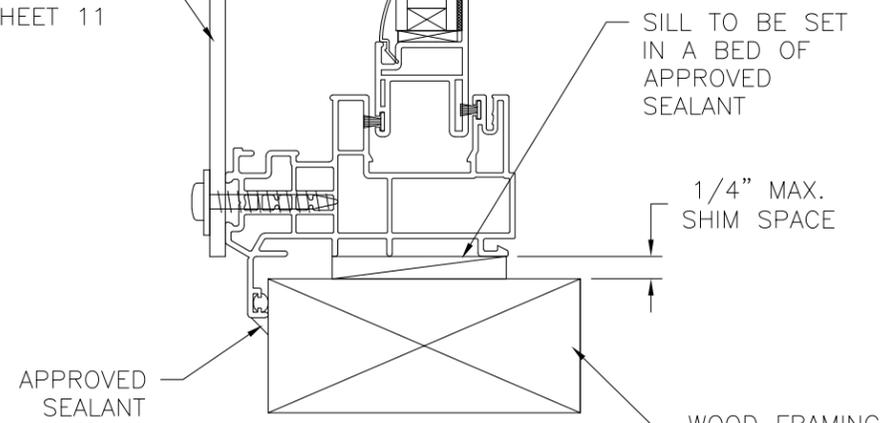

APPROVED SEALANT

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

WOOD FRAMING
OR 2X BUCK
BY OTHERS

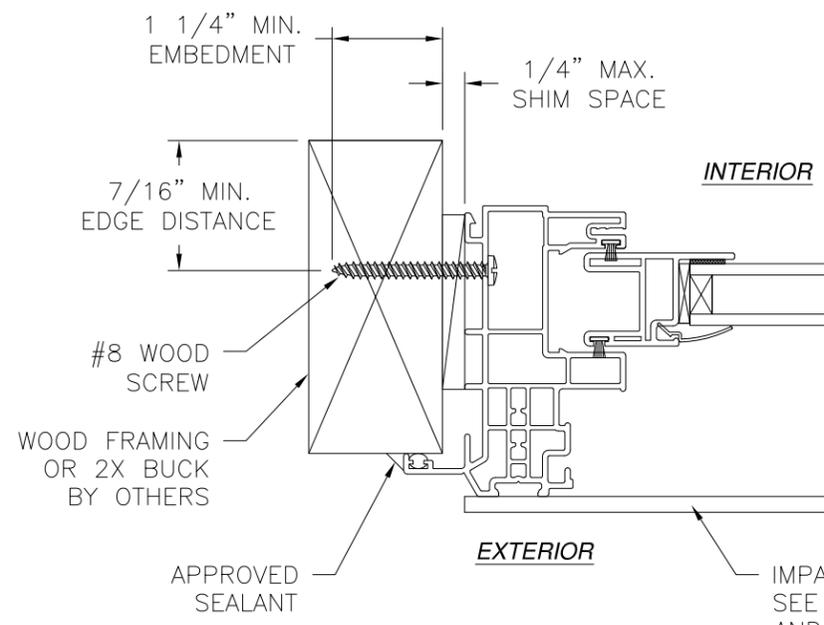

INTERIOR

EXTERIOR

IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC. 1930 HANAHAN ROAD, SUITE 1400A NORTH CHARLESTON, SC 29406		
SERIES 2100 SINGLE HUNG WINDOW W/STORM JAMB - IMPACT INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 4 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

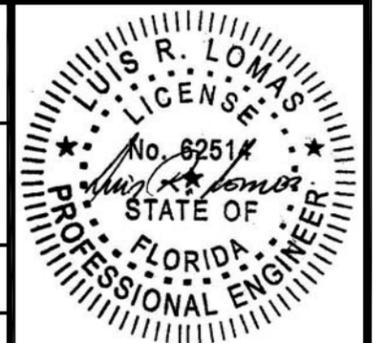

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

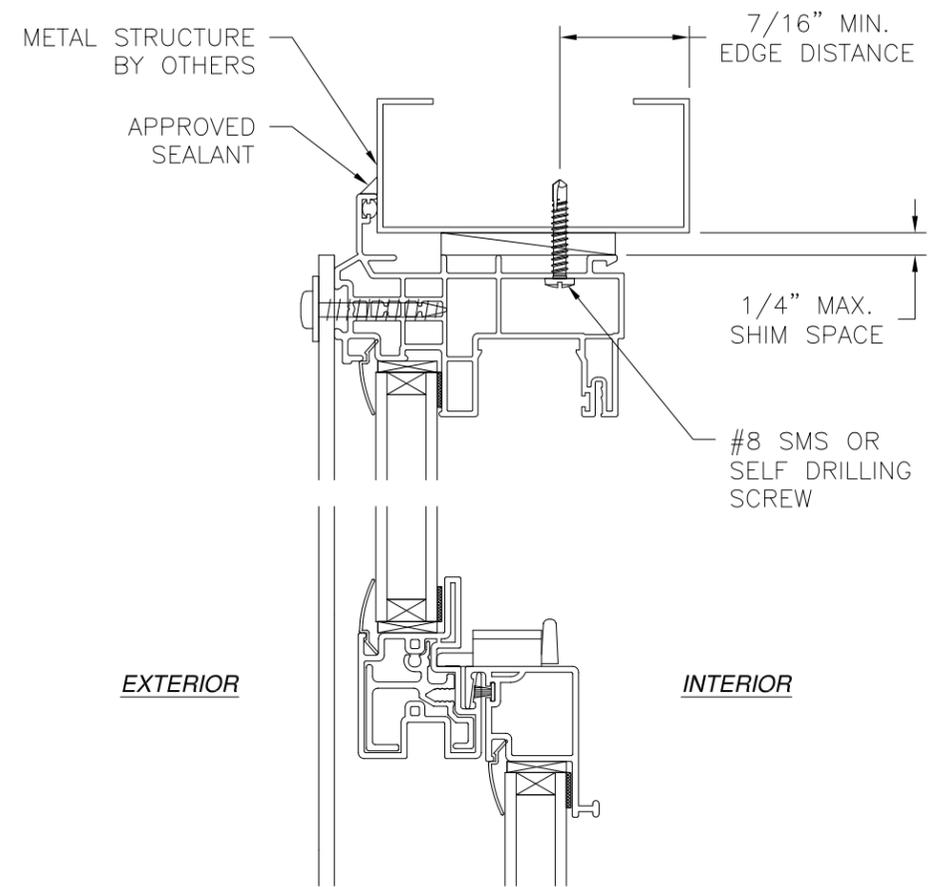

EXTERIOR

INTERIOR

IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11


SILL TO BE SET
IN A BED OF
APPROVED
SEALANT

APPROVED
SEALANT

1/4" MAX.
SHIM SPACE

METAL STRUCTURE
BY OTHERS

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

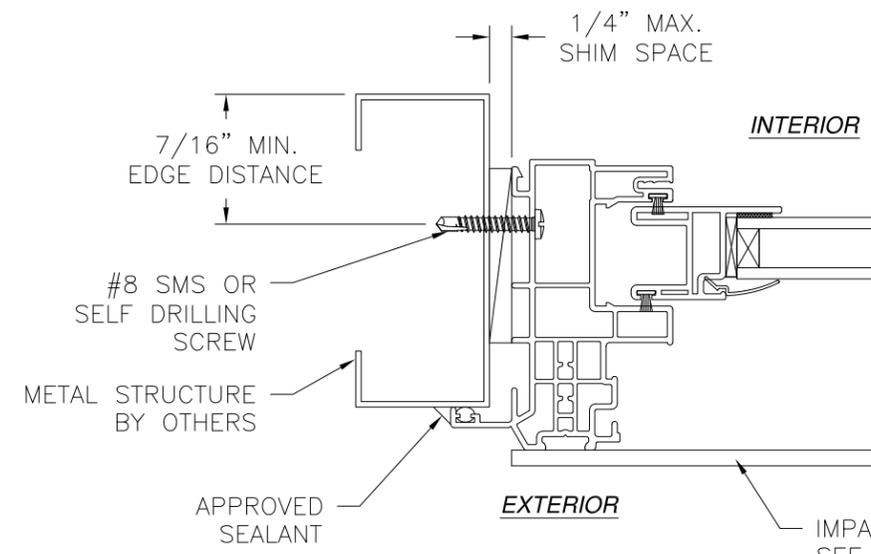

INTERIOR

EXTERIOR

IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC. 1930 HANAHAN ROAD, SUITE 1400A NORTH CHARLESTON, SC 29406		
SERIES 2100 SINGLE HUNG WINDOW W/STORM JAMB - IMPACT INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 5 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

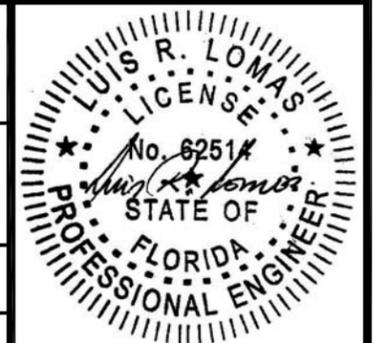


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

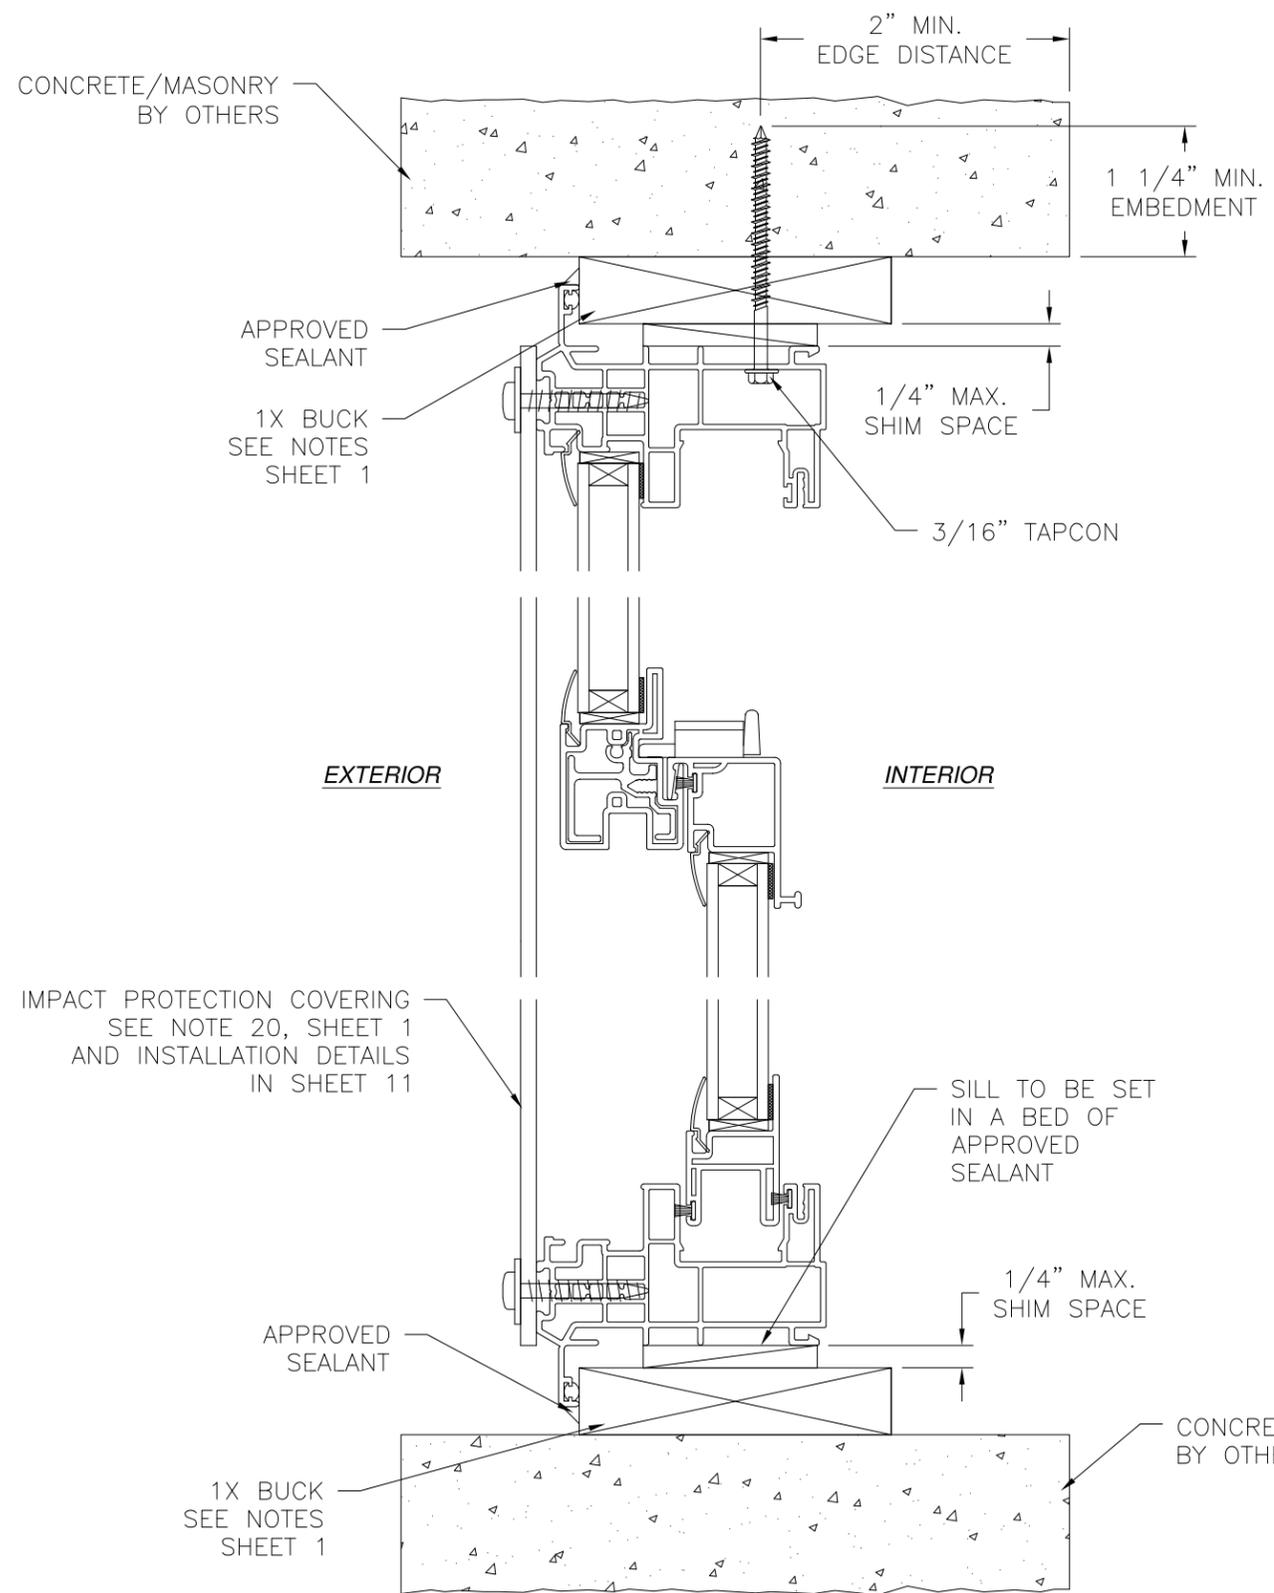

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

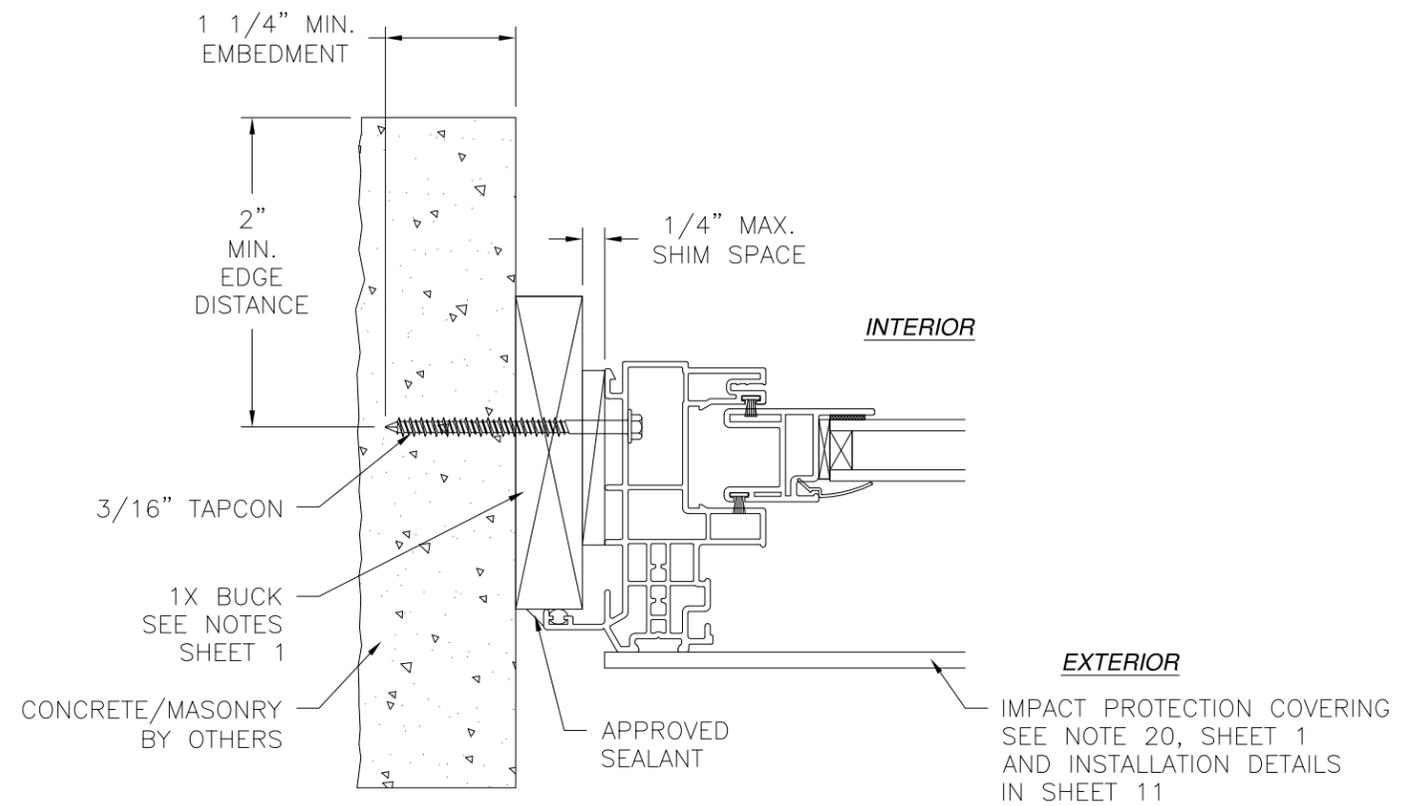

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
1930 HANAHAN ROAD, SUITE 1400A
NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
W/STORM JAMB - IMPACT
INSTALLATION DETAILS




DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 6 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

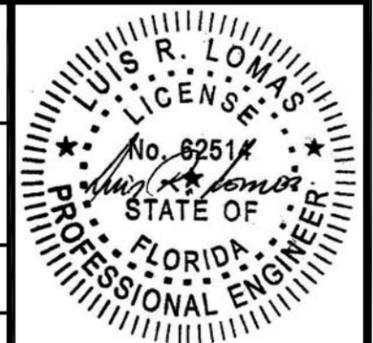

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

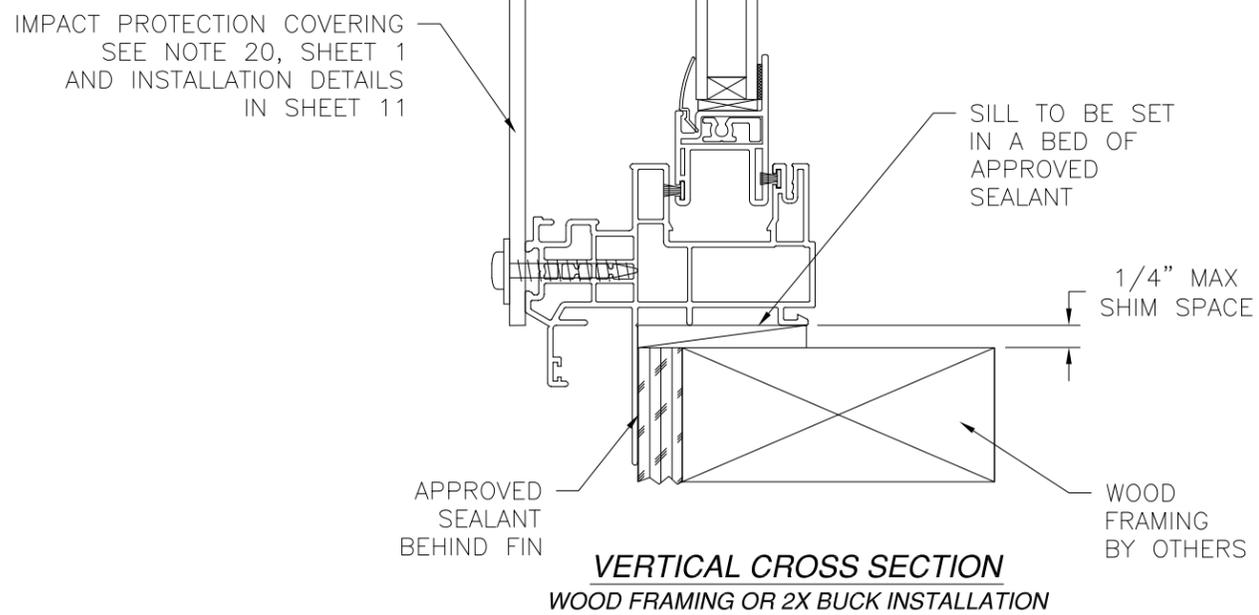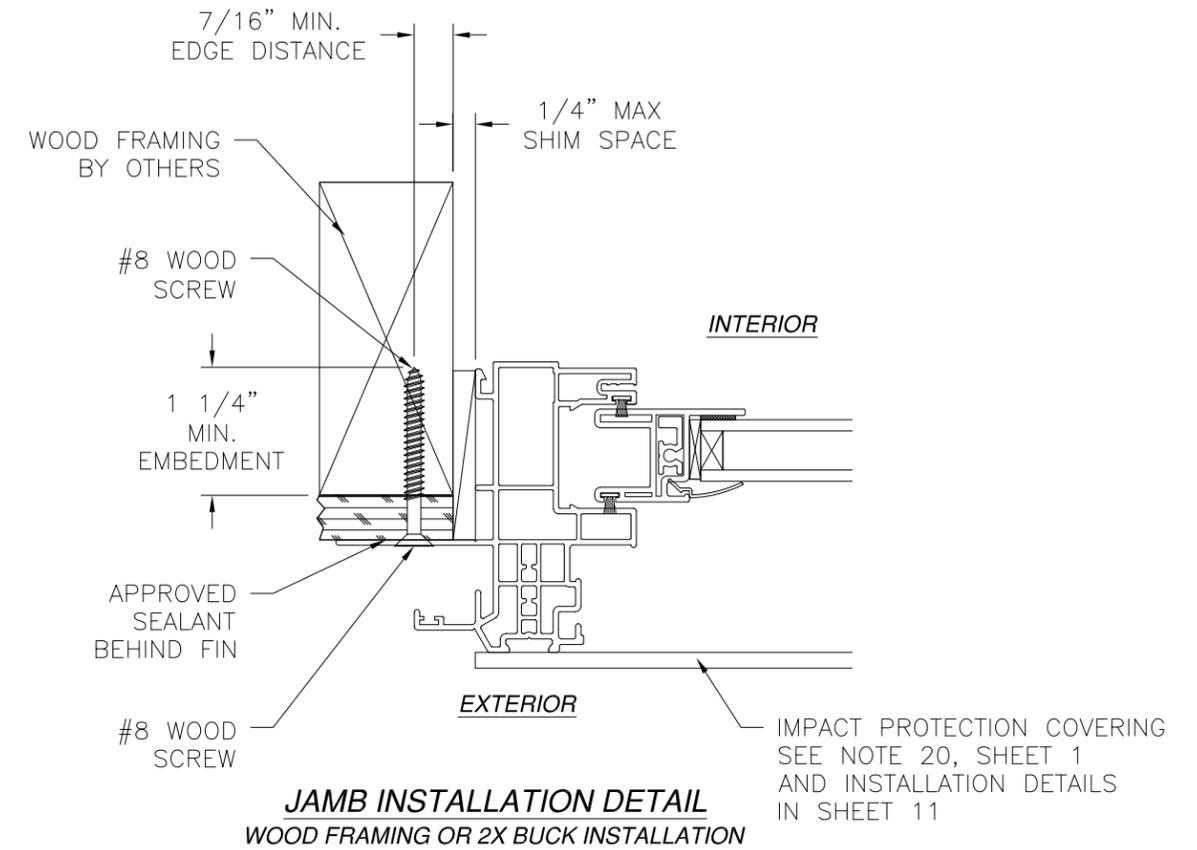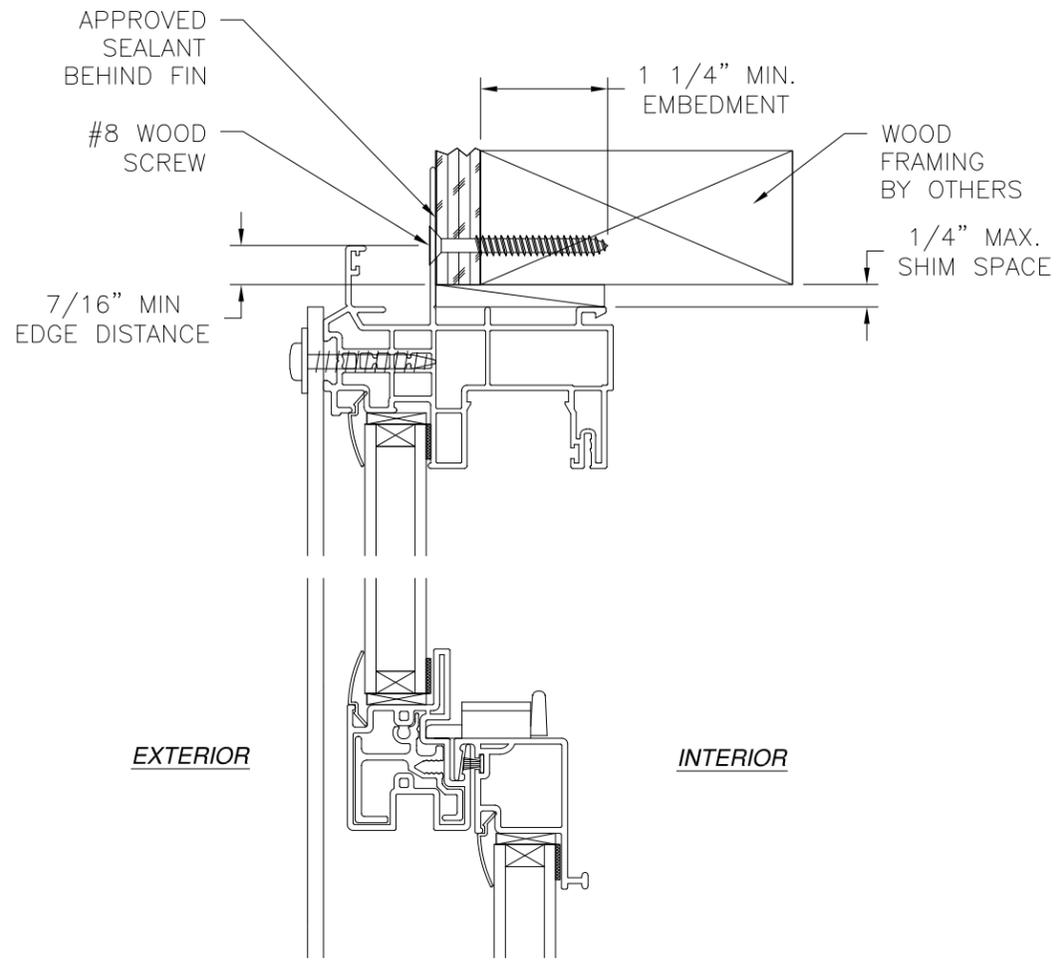

- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
 1930 HANAHAN ROAD, SUITE 1400A
 NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
 W/STORM JAMB - IMPACT
 FIN INSTALLATION DETAILS




DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 7 OF 12

L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@lrlomaspe.com

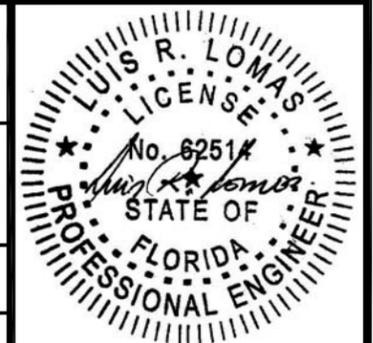

Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

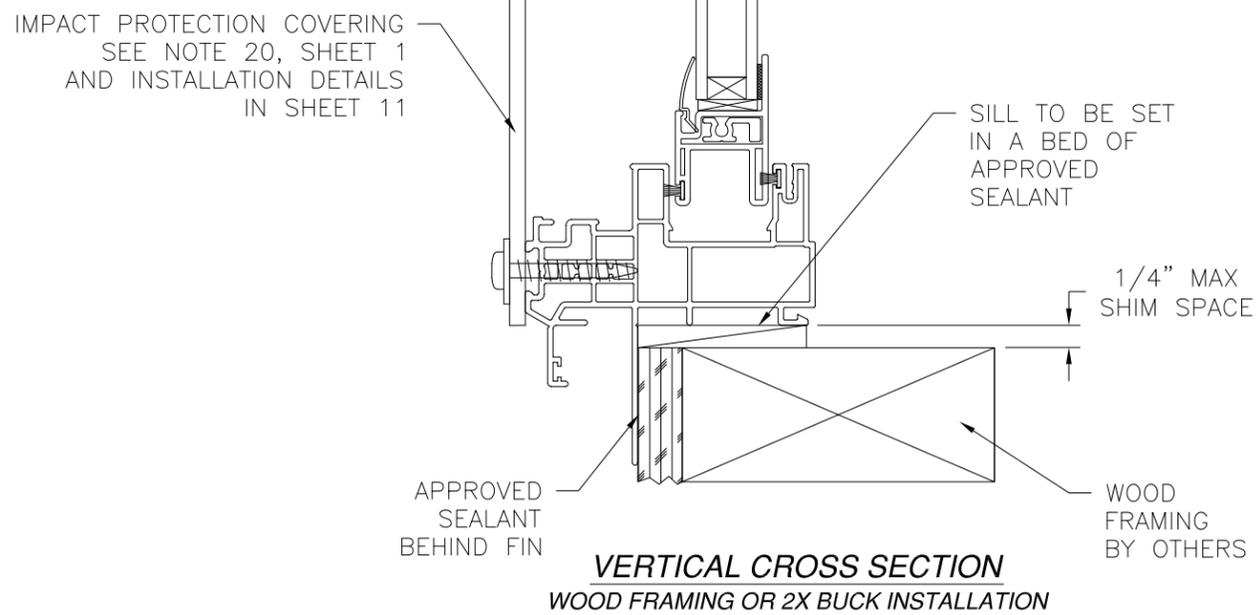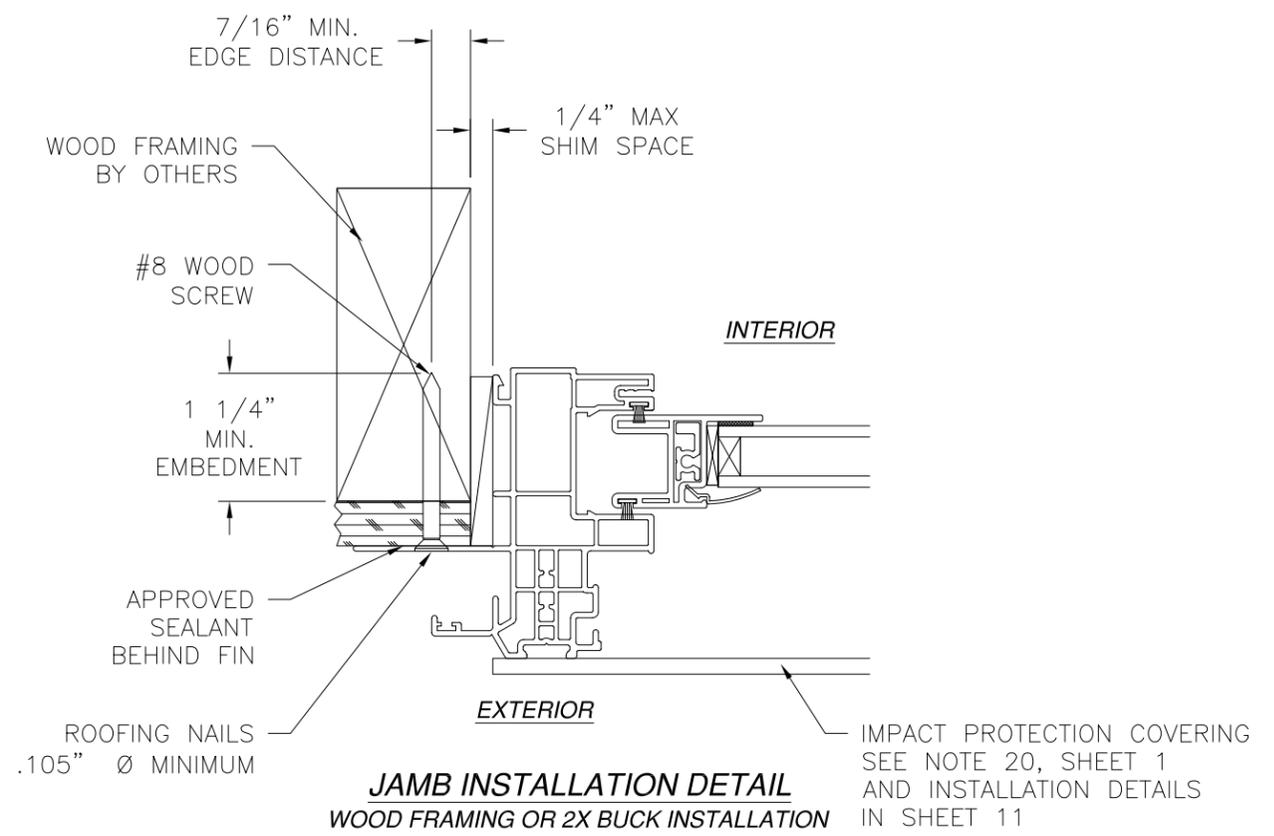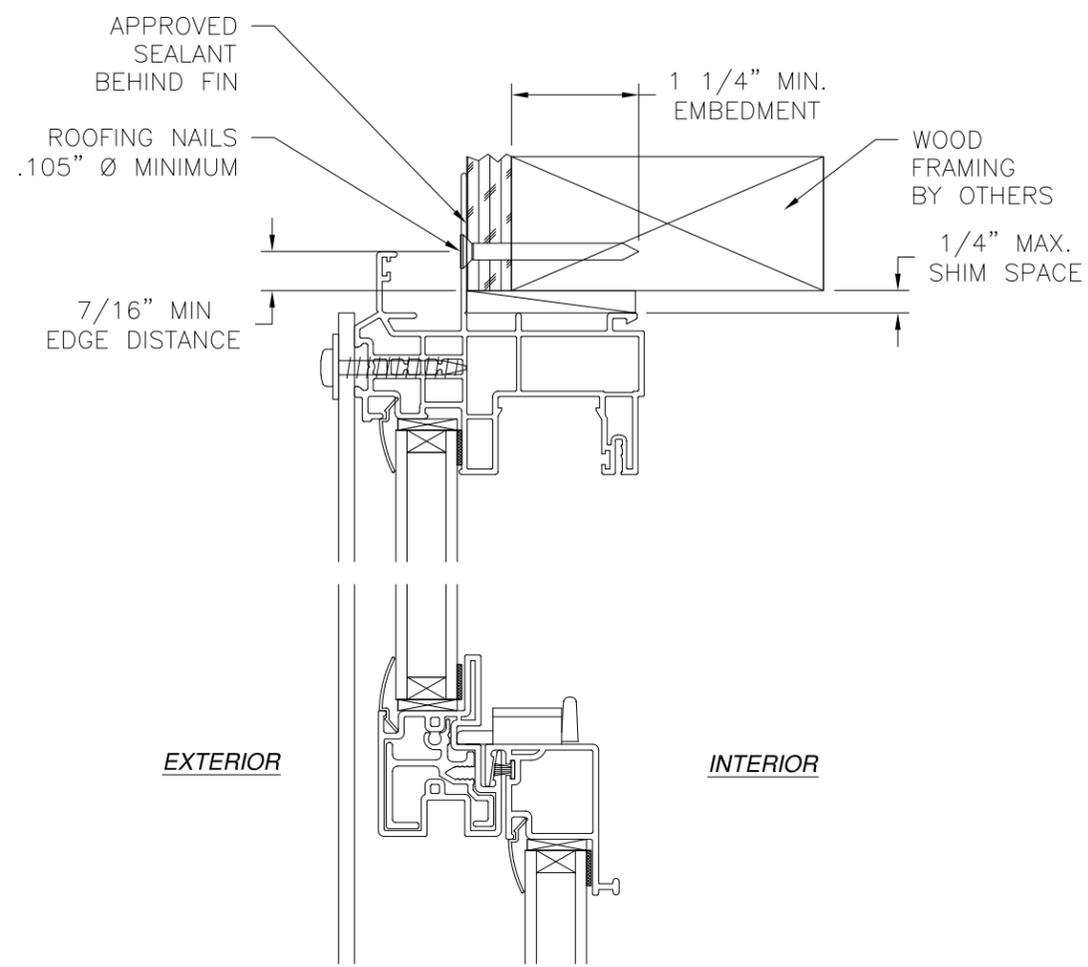

- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
 1930 HANAHAN ROAD, SUITE 1400A
 NORTH CHARLESTON, SC 29406




SERIES 2100 SINGLE HUNG WINDOW
 W/STORM JAMB - IMPACT
 FIN INSTALLATION DETAILS

DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 8 OF 12

L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

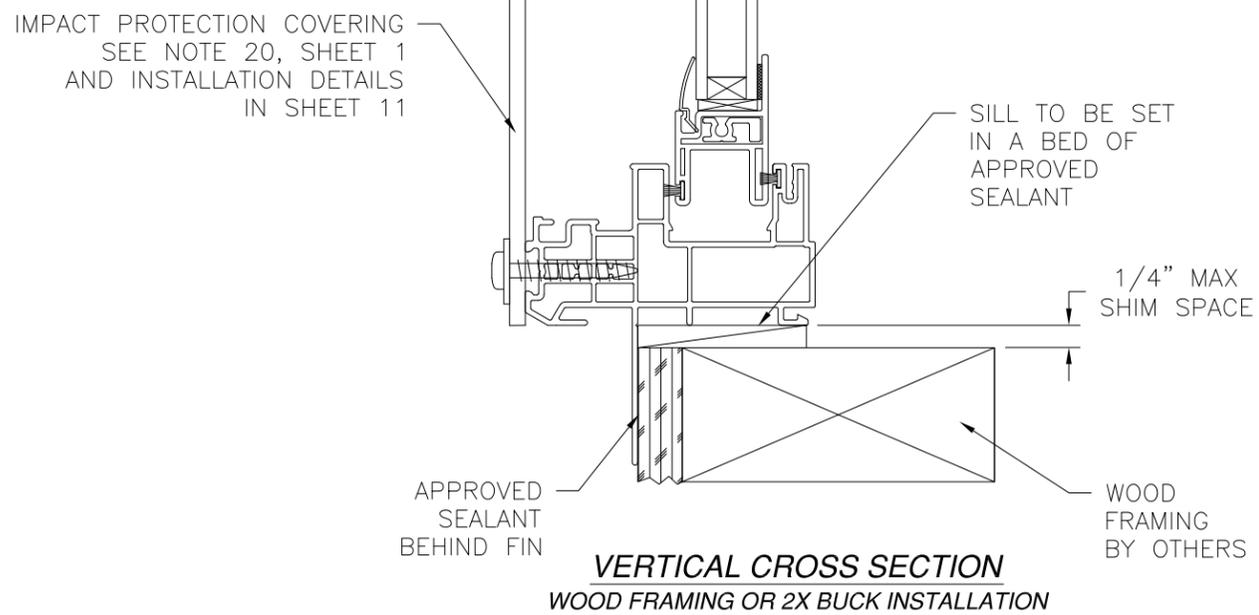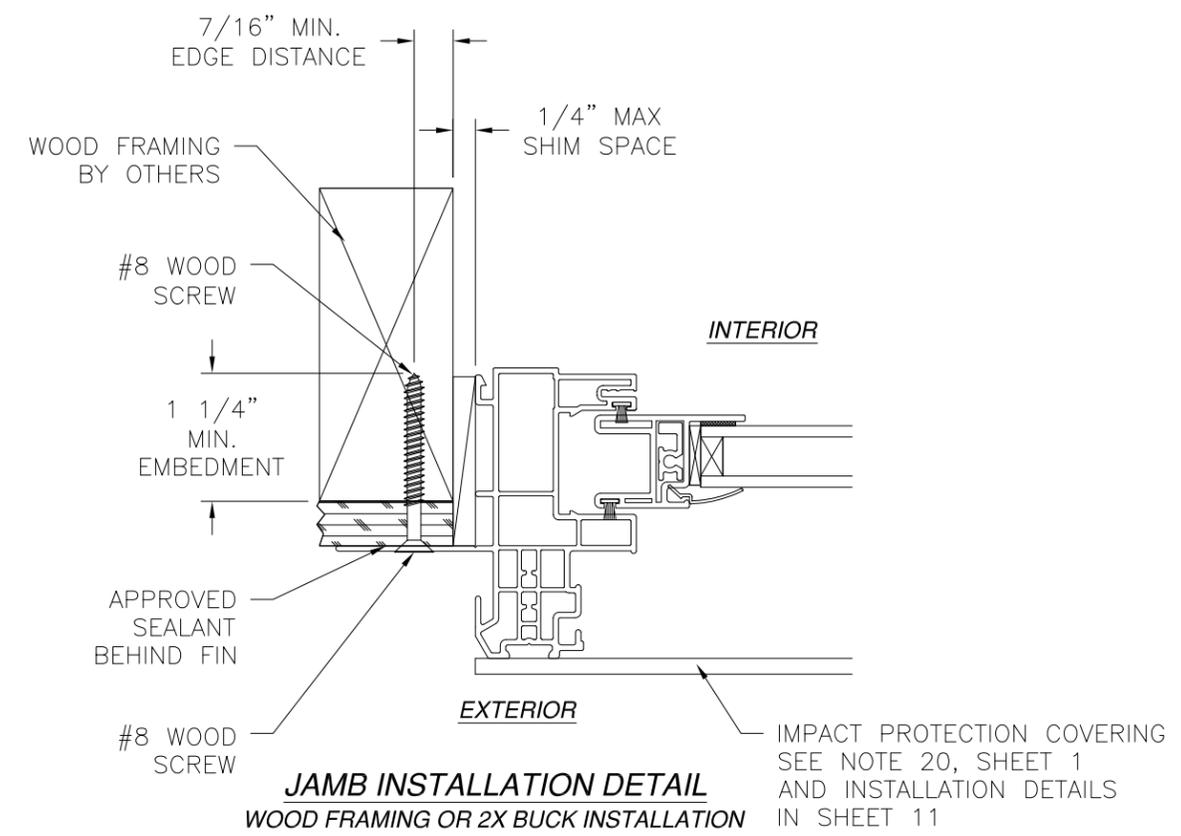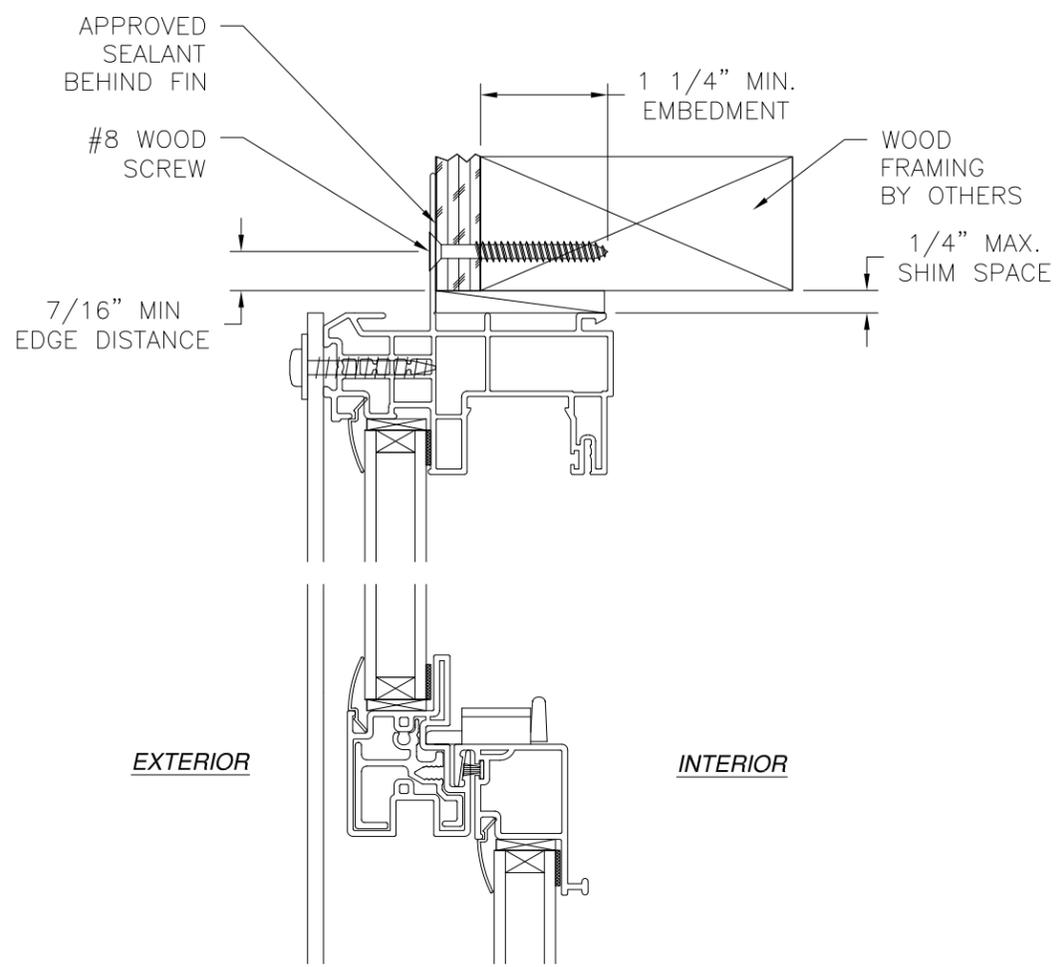

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
 1930 HANAHAN ROAD, SUITE 1400A
 NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
 W/STORM JAMB - IMPACT
 FIN INSTALLATION DETAILS WITHOUT J-CHANNEL



DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 9 OF 12

L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@rlomaspe.com

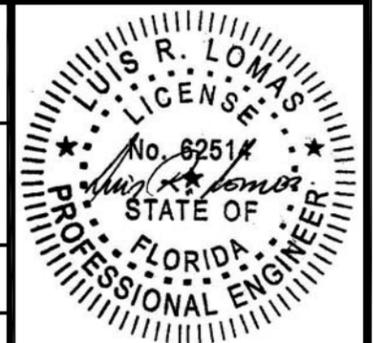

Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

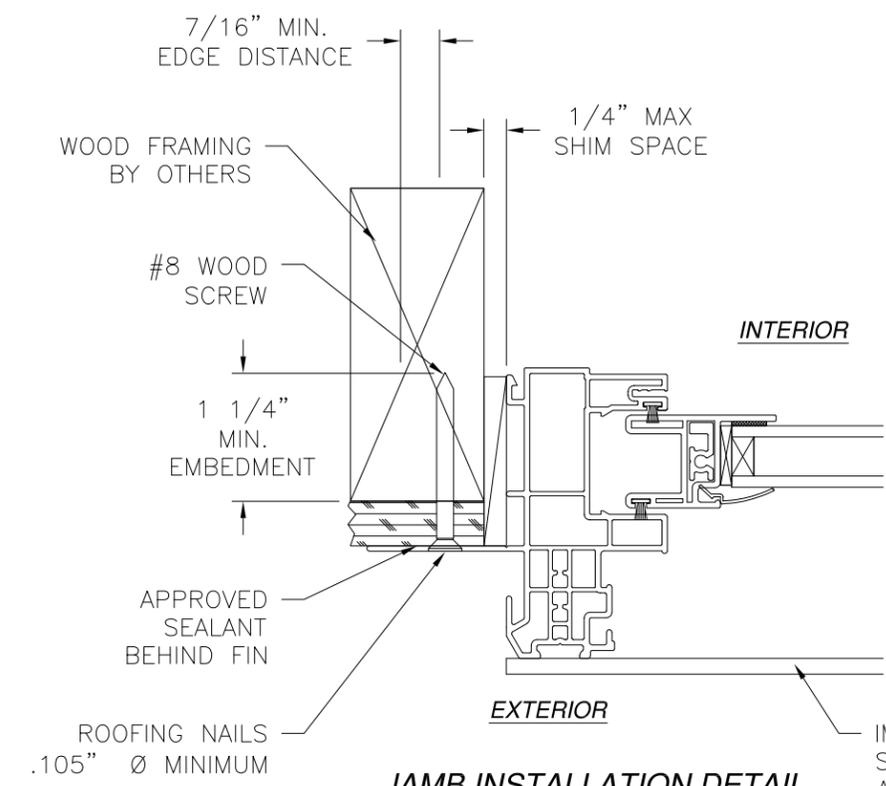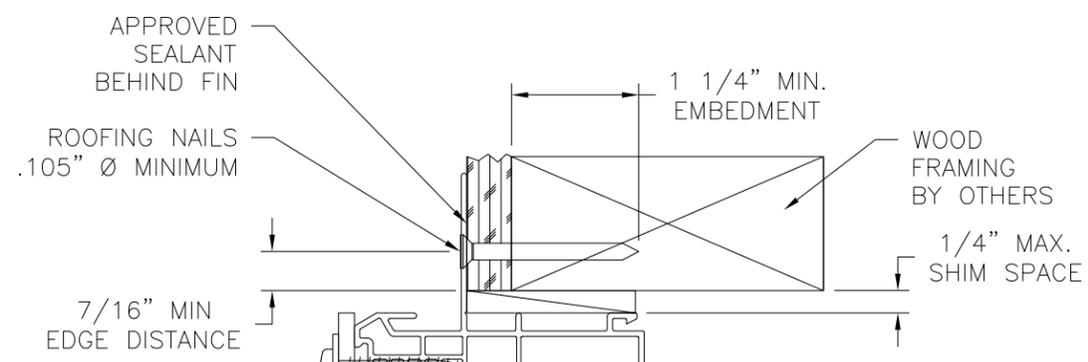

EXTERIOR

INTERIOR

INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11

IMPACT PROTECTION COVERING
SEE NOTE 20, SHEET 1
AND INSTALLATION DETAILS
IN SHEET 11

SILL TO BE SET
IN A BED OF
APPROVED
SEALANT

APPROVED
SEALANT
BEHIND FIN

WOOD
FRAMING
BY OTHERS


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC. 1930 HANAHAN ROAD, SUITE 1400A NORTH CHARLESTON, SC 29406		
SERIES 2100 SINGLE HUNG WINDOW W/STORM JAMB - IMPACT FIN INSTALLATION DETAILS W/ J-CHANNEL		
DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 10 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

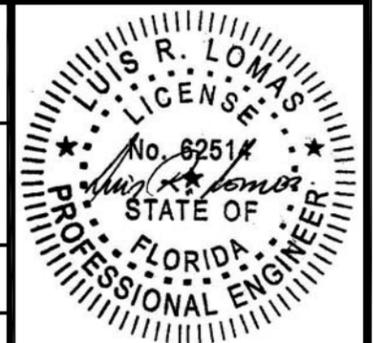


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

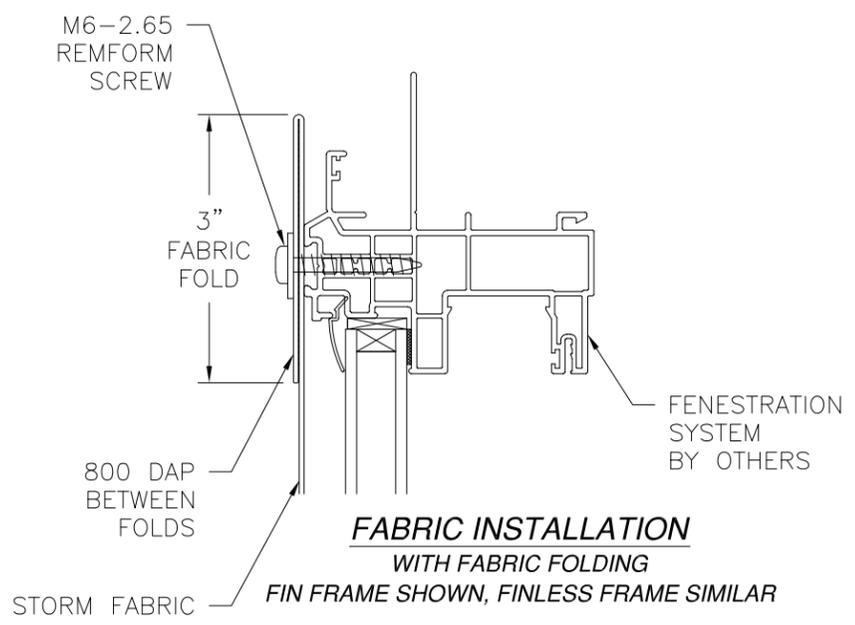


FABRIC INSTALLATION
WITH FABRIC FOLDING
FIN FRAME SHOWN, FINLESS FRAME SIMILAR

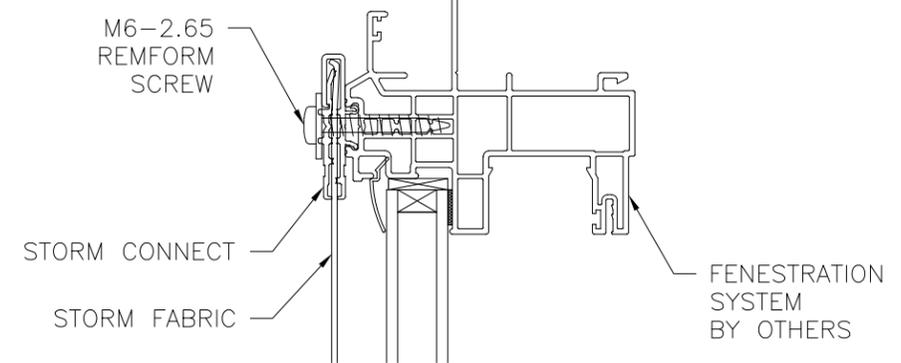


FABRIC INSTALLATION
WITH STORM CONNECT SYSTEM
FIN FRAME SHOWN, FINLESS FRAME SIMILAR

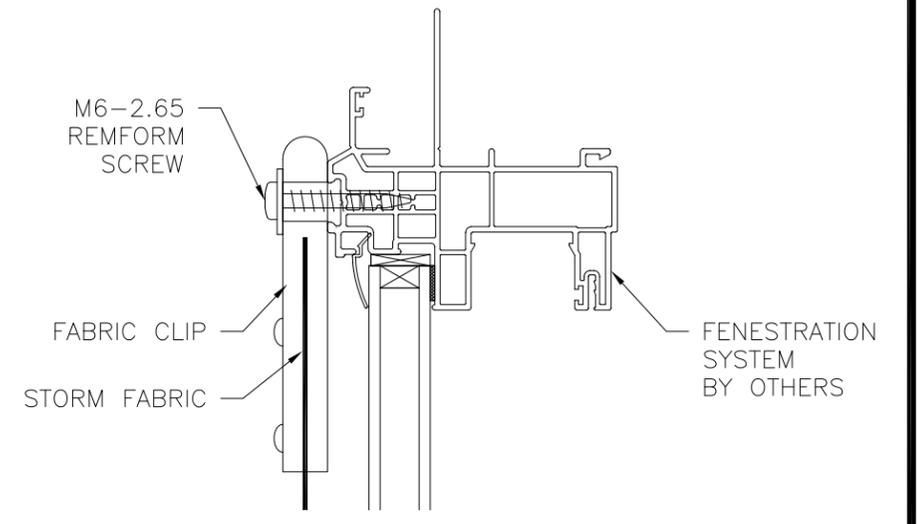

FABRIC INSTALLATION
WITH STORM CONNECT SYSTEM
FIN FRAME SHOWN, FINLESS FRAME SIMILAR

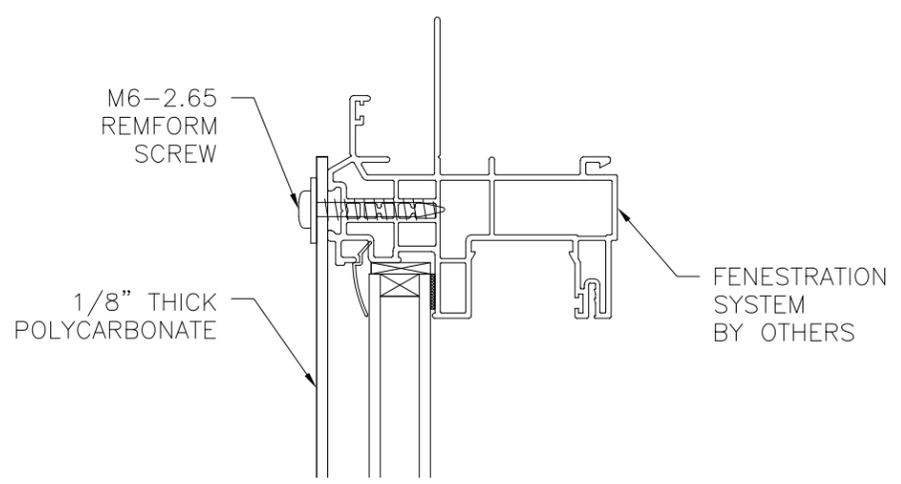

FABRIC INSTALLATION
WITH 1/8" THICK POLYCARBONATE
FIN FRAME SHOWN, FINLESS FRAME SIMILAR

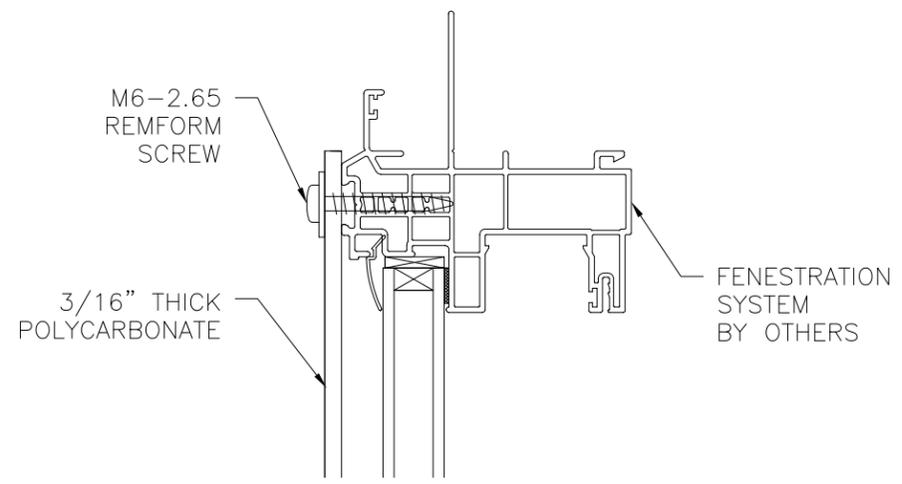

FABRIC INSTALLATION
WITH 3/16" THICK POLYCARBONATE
FIN FRAME SHOWN, FINLESS FRAME SIMILAR


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
1930 HANAHAN ROAD, SUITE 1400A
NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
W/STORM JAMB - IMPACT
IMPACT PROTECTION INSTALLATION DETAILS


DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 11 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

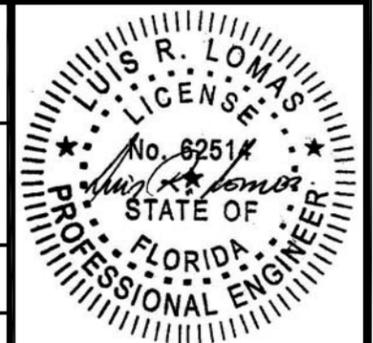


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	01/08/2024	R.L.

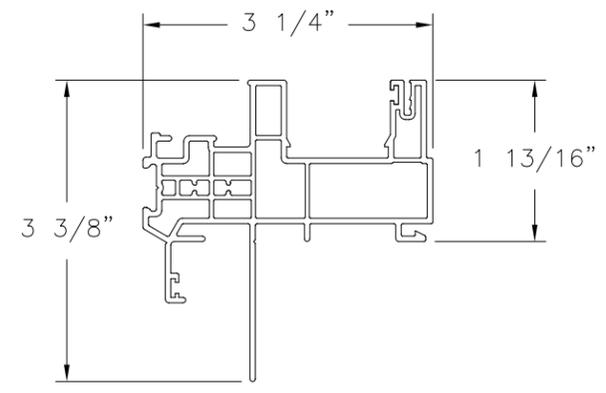


MAIN FRAME (CL-2930)
FIN INSTALLATION
EXTRUDED PVC

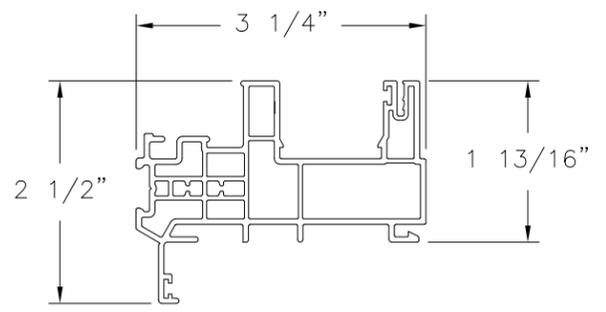


MAIN FRAME (CL-2930)
EXTRUDED PVC

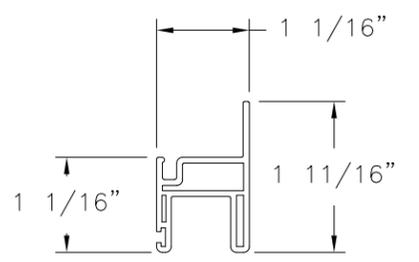


BOTTOM RAIL AND STILE (606007)
EXTRUDED PVC

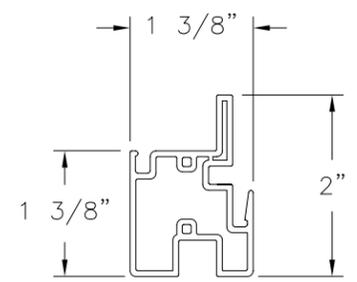


MEETING RAIL (606008)
EXTRUDED PVC

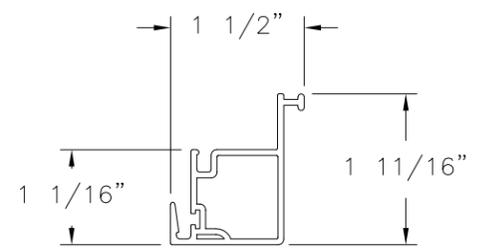

INTERLOCK SASH (606005)
EXTRUDED PVC

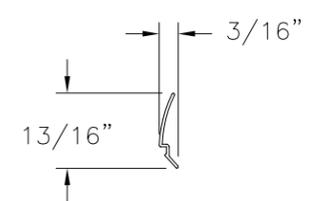

GLAZING BEAD
EXTRUDED PVC

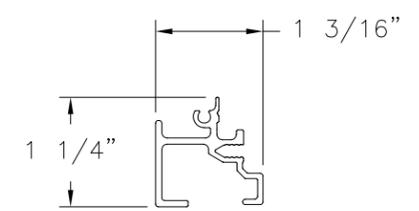

MEETING RAIL REINFORCEMENT (606060)
ALUMINUM 6063-T6


SIGNED: 01/09/2024

ALL AMERICAN WINDOW COMPANY, LLC.
1930 HANAHAN ROAD, SUITE 1400A
NORTH CHARLESTON, SC 29406

SERIES 2100 SINGLE HUNG WINDOW
W/STORM JAMB - IMPACT
COMPONENTS

DRAWN: A.R.	DWG NO. 08-03573	REV A
SCALE NTS	DATE 06/18/2020	SHEET 12 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

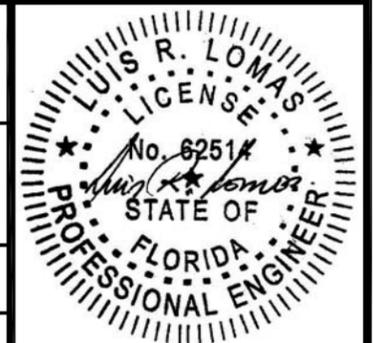

Luis R. Lomas P.E.
FL No.: 62514